



CENTRUM STAVEBNÍHO INŽENÝRSTVÍ, a. s.
CENTRE OF BUILDING CONSTRUCTION ENGINEERING,
Joint Stock Company

Workplace Zlín, K Ciheln 304, 764 32 Zlín - Louky

Door and window testing laboratory, heat and acoustical engineering No. 1007.1, accredited by the Czech Accreditation Institute, o.p.s.



Tests report No. 150/10

Determination of thermal transmittance according to SN EN 12412-2

Order No.: **063 280**

Number of pages
including the annex: **5**
Number of copies: **3**
Copy No.: **1**

Customer: **DECEUNINCK srl – Member of Deceuninck group**
Piazza della Concordia 6
56025 Pontedera (PI), Italy

Manufacturer: **See customer**

Test subject: **The frames of DECEUNINCK ZENDOW PVC Tilt and turn window - P 5001- P 3146**

Test result: **$U_t = 1,17 \text{ W/(m}^2 \cdot \text{K)}$**

Date of receiving specimens: 18.3.2010

Date of test performing: 21.3.2010 – 22.3.2010

Test performed by laboratory: Building thermal engineering

Laboratory head: Ing. Nizar Al-Hajjar

Head of test

laboratory No. 1007.1: Ing. Miroslav Figalla

Accredited testing laboratory declares that the test results refer to nothing else but the subject of the test and do not mean acknowledgement or certification of the product. Without a written consent of the testing laboratory the report must not be reproduced in other than complete form.

Datum: 12.4.2010

1. Test purpose

On the basis of the customer order on 16.2.2010 and the order No. 063 280 the test laboratory of opening infillings, building thermal engineering and acoustics No. 1007.1 CSI Prague, a.s. (Center of Building Construction Engineering, Joint Stock Company) with the place of work in Zlin carried out for the customer DECEUNINCK srl, Member of Deceuninck group, Piazza della Concordia 6, 56025 Pontedera, (PI), Italy, the test of thermal transmittance of The frames of DECEUNINCK ZENDOW PVC Tilt and turn window - P 5001-P 3146 according to SN EN 12412-2.

2. Description of test subject

The test purpose is determination of the thermal transmittance U_f found by measurement according to **SN EN 12 412-2, article 5.3.1** "Thermal performance of windows, doors and shutters - Determination of thermal transmittance by hot box method - Part 2: frames". The measured value of thermal transmittance U_f is determined on the basis of following equation:

$$U_f = \frac{U_{m,t} A_t \frac{n - f_i}{A_f} - \frac{s_{,fi} A_{fi}}{n}}{A_f} \quad \text{W/(m}^2 \text{ K)}$$

where $U_{m,t}$ is the measured thermal transmittance of the infill insulation and the frame, in W/(m² K);

A_f the frame area; frame area is the larger of two projected areas seen from both sides, in m²;

A_{fi} the remaining area of the infill insulation ($A_{fi} = A_t - A_f$), in m²

A_t the projected metering area, in m²;

n the difference between the environmental temperature on each side of the test specimen under test, in K;

f_i the thermal conductance of the infill insulation, in W/(m² K);

$s_{,fi}$ the surface difference temperature of the infill insulation, in K.

3. 3. Description of testing products - Test specimen No. 153/10

Technical documentation: Test specimen scheme and cross section - see annex No.1.

Description:

Frame and sash	Frame P 5001, frame reinforcement P 3220, thick. 1,5 mm; sash P 3146, sash reinforcement: P 3214, tl. 1,5 mm; manufacturer of PVC, reinforcement and sealing profiles: Deceuninck NV
Other profiles	glazing bead P 3024
Sealing	inner and outer gasket between the sash and the frame P 3299; outer gasket of infilling panel P 3299
Infilling panel	Infilling panel with total thickness 23,5 mm and compound of: PVC 2x1,5 mm; XPS 20,5 mm
Drainage and decompression	Drainage and decompression of the sash 2 holes with diameter 6 mm, frame drainage 3 holes with diameter 6 mm, decompression not performed
Hardware	All-Peripheral - Siegenia – Favorit SI Line, 7- point closure, handle

Size:	Window frame:	1 200 mm x 1 500 mm
	Sash:	1 125 mm x 1 425 mm
	Relative frame area:	32,2 % window area
	Glazing:	965 mm x 1 265 mm
	Relative glazing area:	67,8 % window area

Infill panel: Infill panel with total thickness 23,5 mm and compound of: PVC 2x1,5 mm; XPS 20,5 mm. One specimen of 800 mm x 800 mm size was prepared from infill insulating panel after profile thermal transmittance testing. Thermal resistance test was performed on this specimen by means of guarded hot plate (P 80) Z 07 3010 according to ISO 8302. The average measured value of Thermal resistance of the infill panel is: $R = 0,6149 \text{ m}^2\cdot\text{K/W}$ for mean temperature $t_{st} = 10,11 \text{ }^\circ\text{C}$.

Condition of samples upon receipt: without apparent deficiencies.

4. TESTING REGULATIONS USED AND TESTING EQUIPMENT

4.1 Regulations

- | | |
|---------------------|------------------|
| - SN EN ISO 12567-1 | Testing standard |
| - SN 73 0540 | Related standard |

4.2 Used apparatus and equipment

- | | |
|---|-----------|
| - Vertical chamber | Z 07 3008 |
| - Push-pulling rule | M 07 1104 |
| - Raking balance weighing machine up to 200kg | M 07 1020 |
| - Digital thickness gauge | M 07 1098 |
| - Digital depth gauge | M 07 1099 |
| - Electric thermometer | M 07 1034 |
| - Wattmeter | M 07 1069 |

5. Deviations from testing methods and procedures

6. Description of used non-standardized method

7. Results of measurement

Average air temperature in the laboratory during the measurement: 20,1 $^\circ\text{C}$

Average relative humidity in the laboratory: 49 %

Table of measured values

Measured quantity		Physical unit	Measurement results Test specimen No. 153/10
Inside air temperature	t_{ni}	$^\circ\text{C}$	20,45
Outer air temperature	t_{ne}	$^\circ\text{C}$	0,30
Input power to hot box	P_{in}	W	47,231
Surround panel heat flow	$\dot{Q}_{sur}$	W	1,787
The heat flow rate through the edge zone	$\dot{Q}_{edg}$	W	1,890
Test specimen heat flow	$\dot{Q}_f$	W	13,667
Total surface thermal resistance	$R_{s,t}$	$\text{m}^2\cdot\text{K/W}$	0,197
Thermal transmittance	U_f	$\text{W}/(\text{m}^2\cdot\text{K})$	1,171
Time of measuring in stable state		hod	8
Projected test specimen area	A_f	m^2	0,5793
Relative frame and sash area	A_f / A_t	%	32,2

Air speed on the cold side 1,8 m/s; air flow direction up along the specimen

Air speed on the warm side 0,1-02 m/s; air flow direction up along the specimen


Hot box area $A_{HB} = 2,465 \text{ m}^2$.

Thermal resistance of surround panel in $\text{m}^2 \text{ K/W}$:

$$R_{\text{sur}} = (d_{\text{sur}} / \lambda_{\text{sur}}); \lambda_{\text{sur}} = 0,03179 + 0,00012 \cdot t_{\text{me,sur}}$$

where λ_{sur} is thermal conductivity of testing surround panel in W/(m K);
 d_{sur} the thickness of testing surround panel, its value is 0,250 m;
 $t_{\text{me,sur}}$ the mean temperature value of both surfaces of testing surround panel in °C.

Linear thermal transmittance $\psi_{\text{edge}} = 0,01738$ W/(m K).
 The scheme of the testing equipment is in figure1.

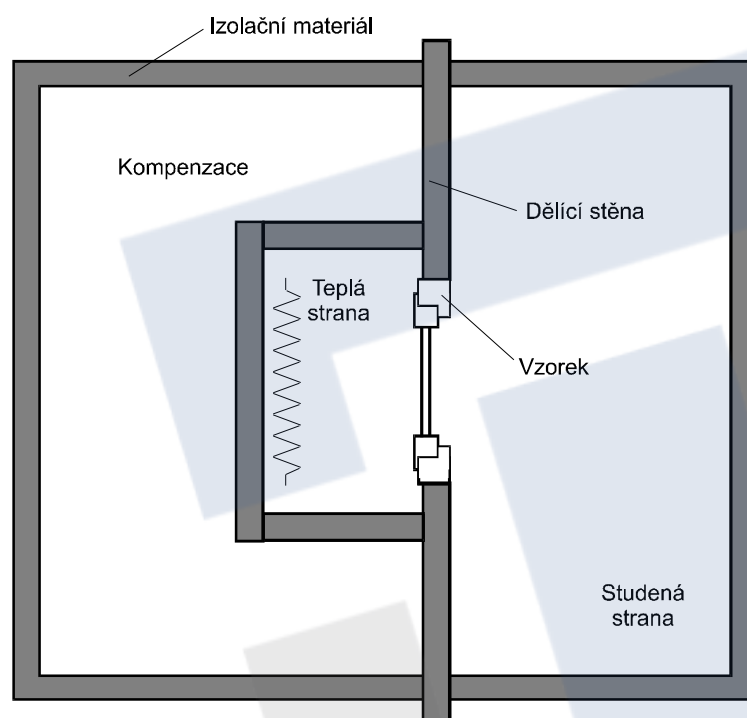

Key: Kompenzace: Compensation; Dělicí stěna: Surround Panel; izolační materiál: Insulating material; Vzorek: Specimen; Teplá strana: Warm side; Studená strana: Cold side
figure1 - Testing equipment scheme

8. Evaluation

Serial No.	Parameter title	Technical regulation Requirement	Testing method	Test specimen No.	Test result Requirement conformity
1.	Thermal transmittance U_f [W/(m ² .K)]	SN 73 0540 Part 2 $U_f \leq 1,70$	SN EN 12412-2	154/10	1,17 Conformity

The given result is in accordance with the document ILAC – G8:1996.

The extended measurement uncertainty of thermal transmittance is $U_0 = \pm 6,0 \%$.

Responsible for the test:
 Report elaborated by:

Petr Pokorný
 Ing. Nizar Al-Hajjar

Annex No. 1

P 5001 – P 3146

